

[REDACTED]

From: [REDACTED]
Sent: Wednesday, July 14, 2021 5:33 PM
To: [REDACTED]
Subject: FW: Report #1 (Initial) - Dixie, Oroville, Butte County

Importance: High

Hi [REDACTED]

Please let me know what updates you have for the summary. I updated based on the info in Teams throughout the day.

Can you confirm the acreage/containment and outages?

From: HAWC <HAWC@pge.com>
Sent: Wednesday, July 14, 2021 10:18 AM
To: HAWC <HAWC@pge.com>
Subject: Report #1 (Initial) - Dixie, Oroville, Butte County



Incident Report Number: 1 (Initial)
Date: 07/14/21
Time: 1017
Incident Type: Vegetation
Incident Name: Dixie
Lead Agency: USDA Forest Service/CAPNF - Plumas National Forest / CAL FIRE

Incident Location: HWY 70 [39.874,-121.378](#)
City/Community: Oroville
County: Butte
PG&E Division: North Valley
PSS Assigned: [REDACTED]

FIA: 248

Tier: Tier 3

Acreage: 1,200

Containment %: 0

Outages: Yes

Max Customers Impacted: 4

Current Customers Impacted: 3

Current Summary:

The Dixie Fire is approximately 1,200 acres, 0% contained and burning in steep and inaccessible terrain north of Highway 70 underneath PG&E's Distribution and Transmission line assets. The fire is burning in North and West underneath the CAFF 115KV. The fire is spotting over the U Line Rd to the North. The fire continues to burn away from the community of Concow. downslope winds that may occur this evening.

SIPT resources (E-211 and 213) pre-treated approximately 30 structures along Highway 70 on the BUCKS CREEK 1101 circuit. In downslope winds SIPT began pre-treating assets on the BIG BEND 1101 circuit this afternoon.

PSS [REDACTED] will continue to provide remote support for PSS [REDACTED] for reporting purposes as there is little to no communication from the Feather River Canyon.


Smoke visible on [multiple wildfire cameras](#).

Assets Potentially at Risk:


- Distribution: Bucks Creek 1101
- Transmission: Bucks Creek-Rock Creek-Cresta – 230kV, Caribou-Palermo – 115kV, Rock Creek-Poe – 230kV, Caribou-Palermo – 115kV
- Gas T and D Line: None at this Time
- Telecom: None at this Time
- Hydro: Cresta Dam
- Others: None at this Time

WSOC Hotline # [REDACTED]


Overview:

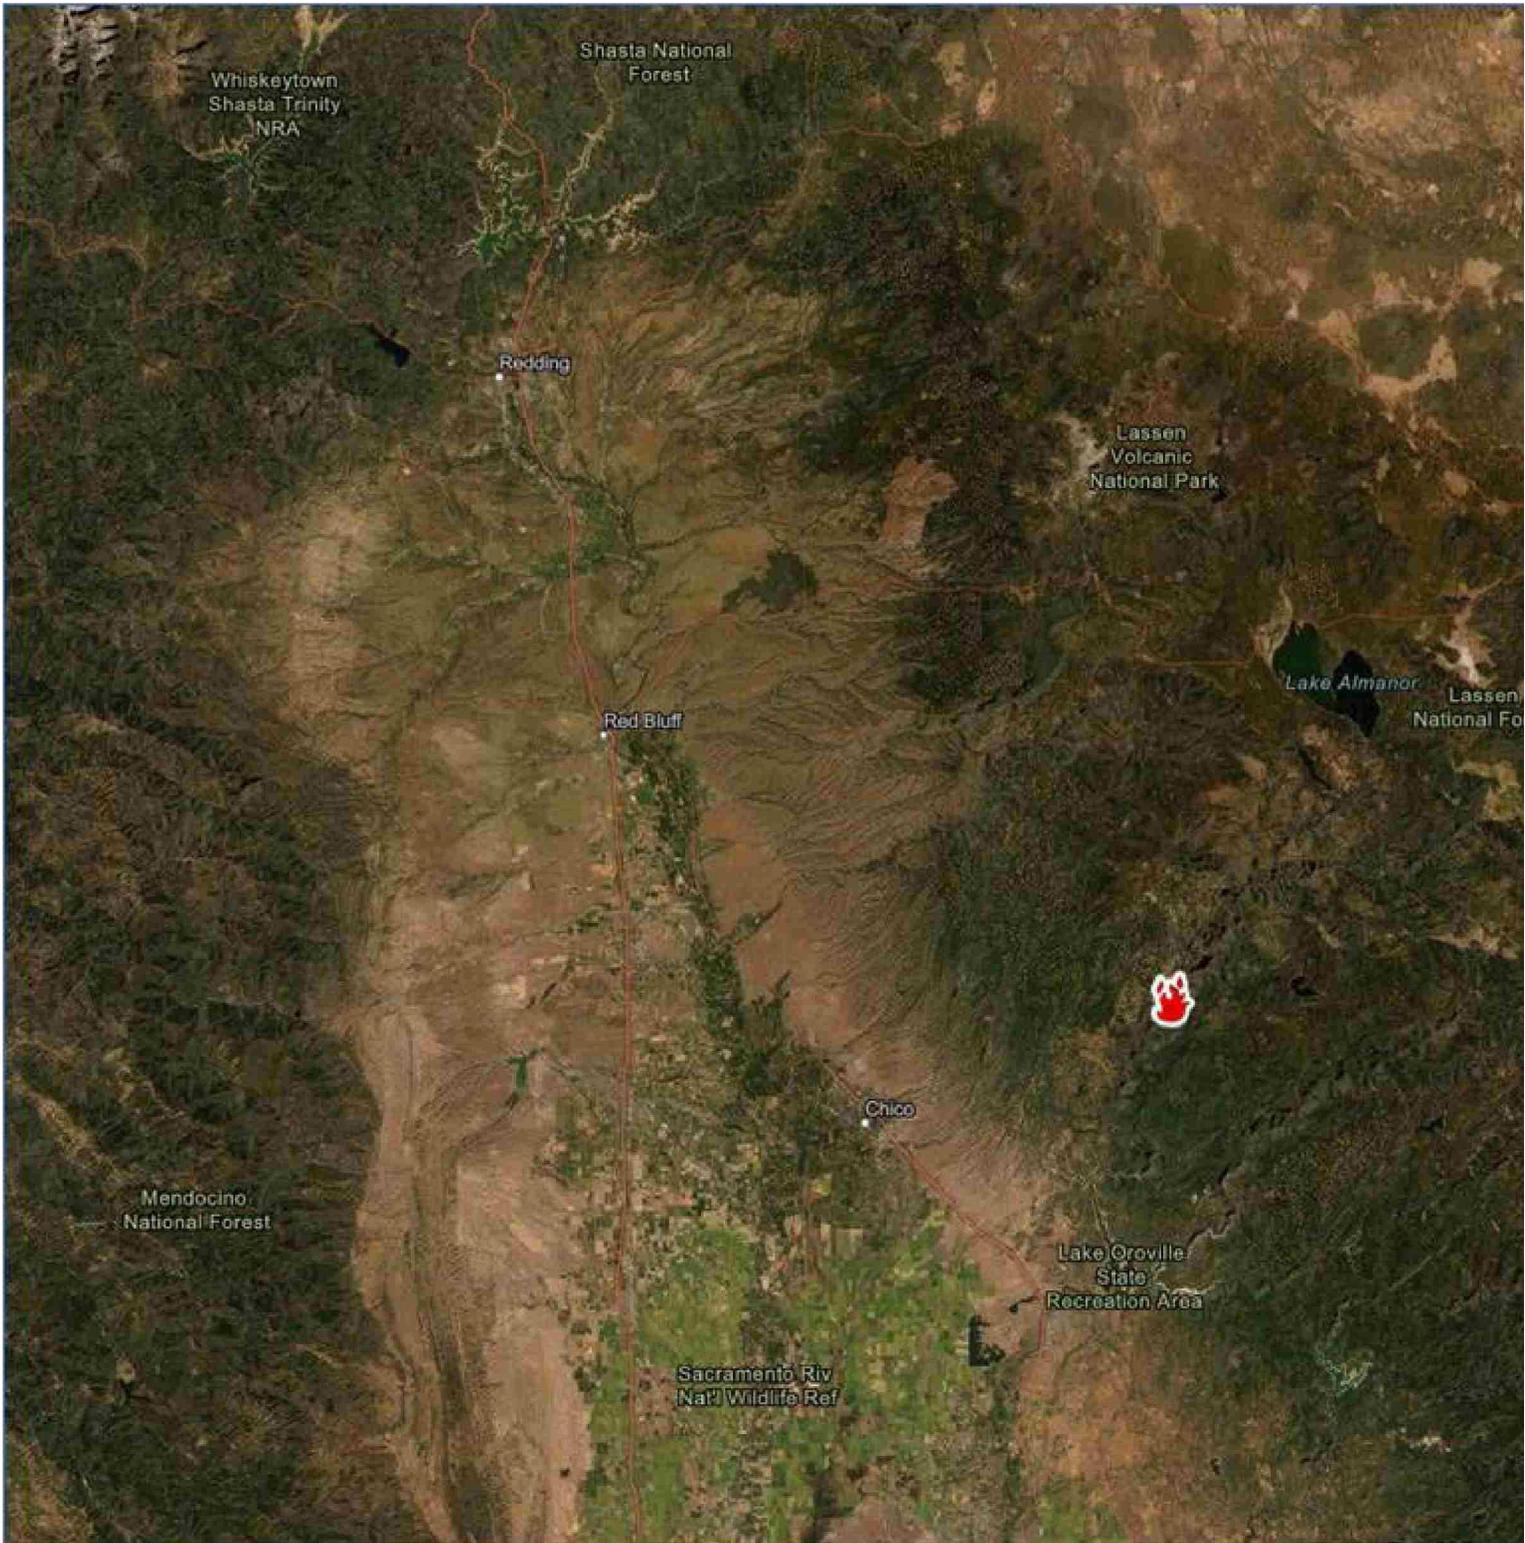

Detail:

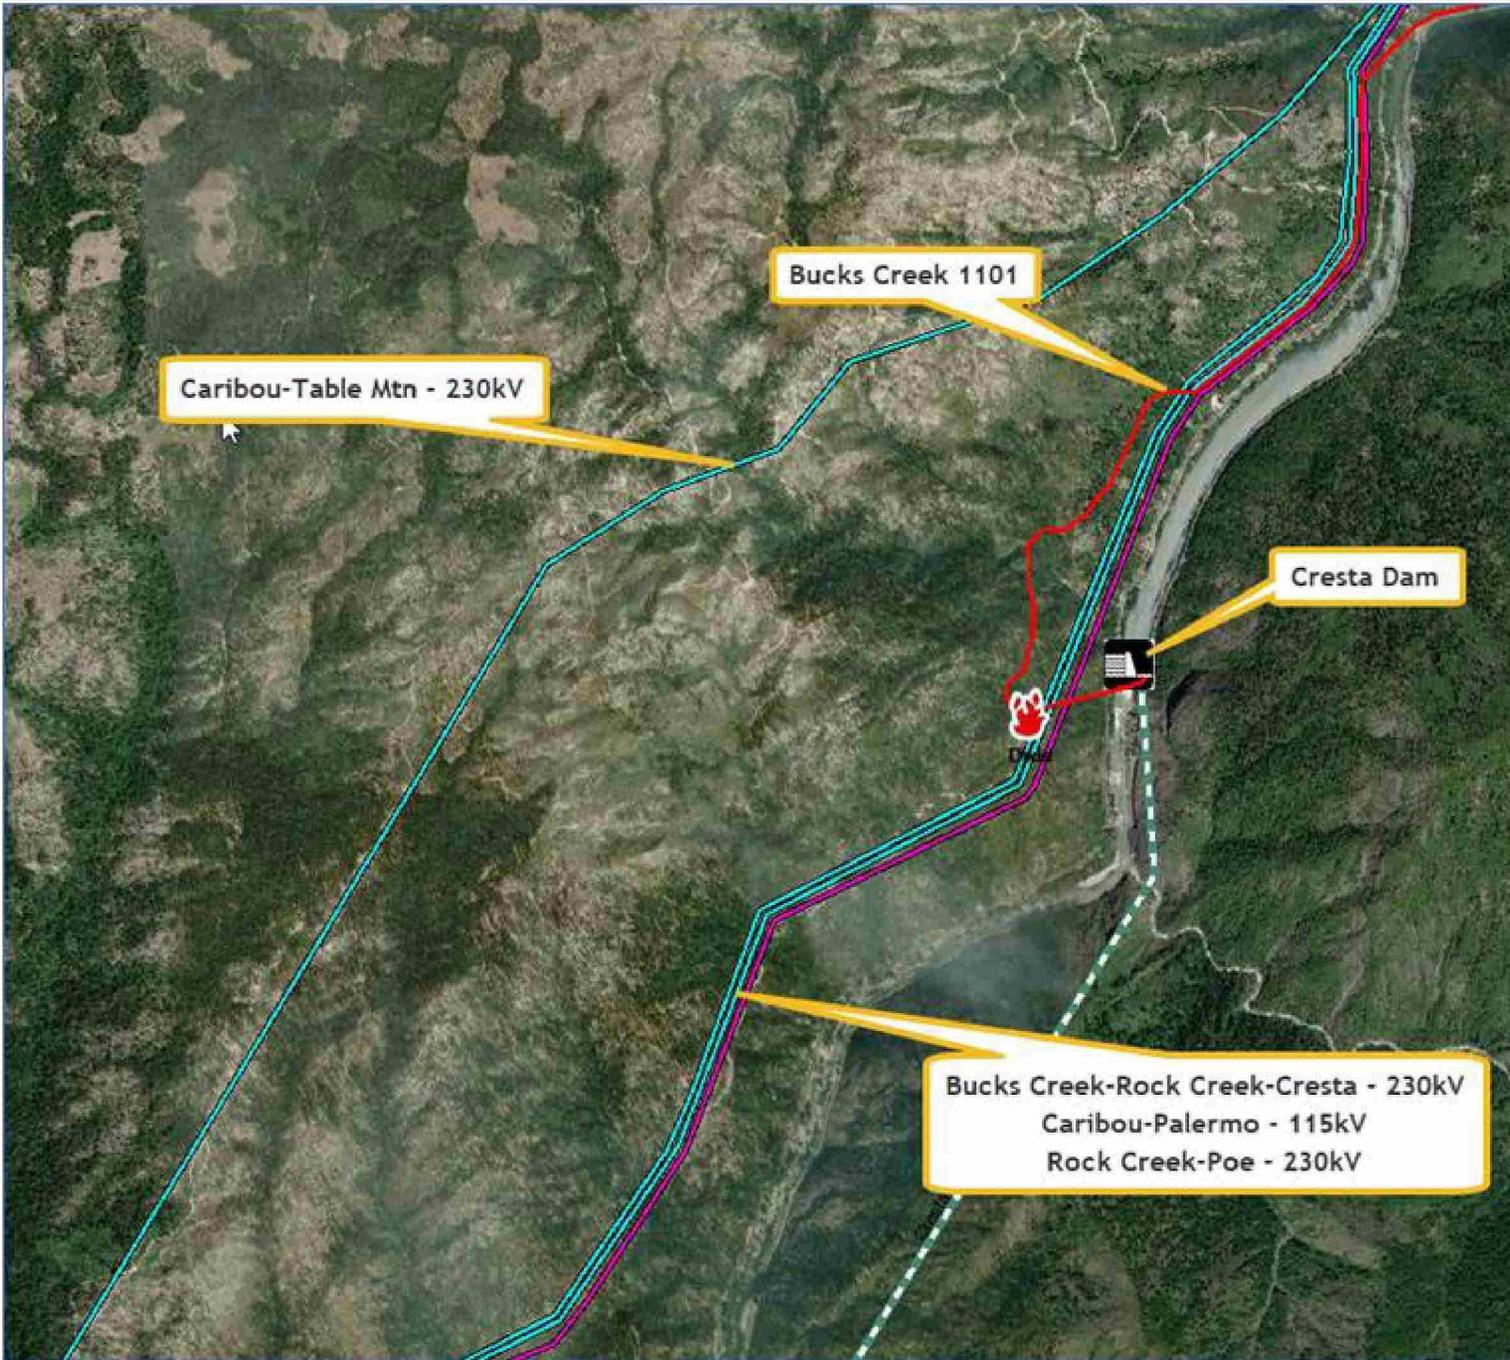

Orientation:

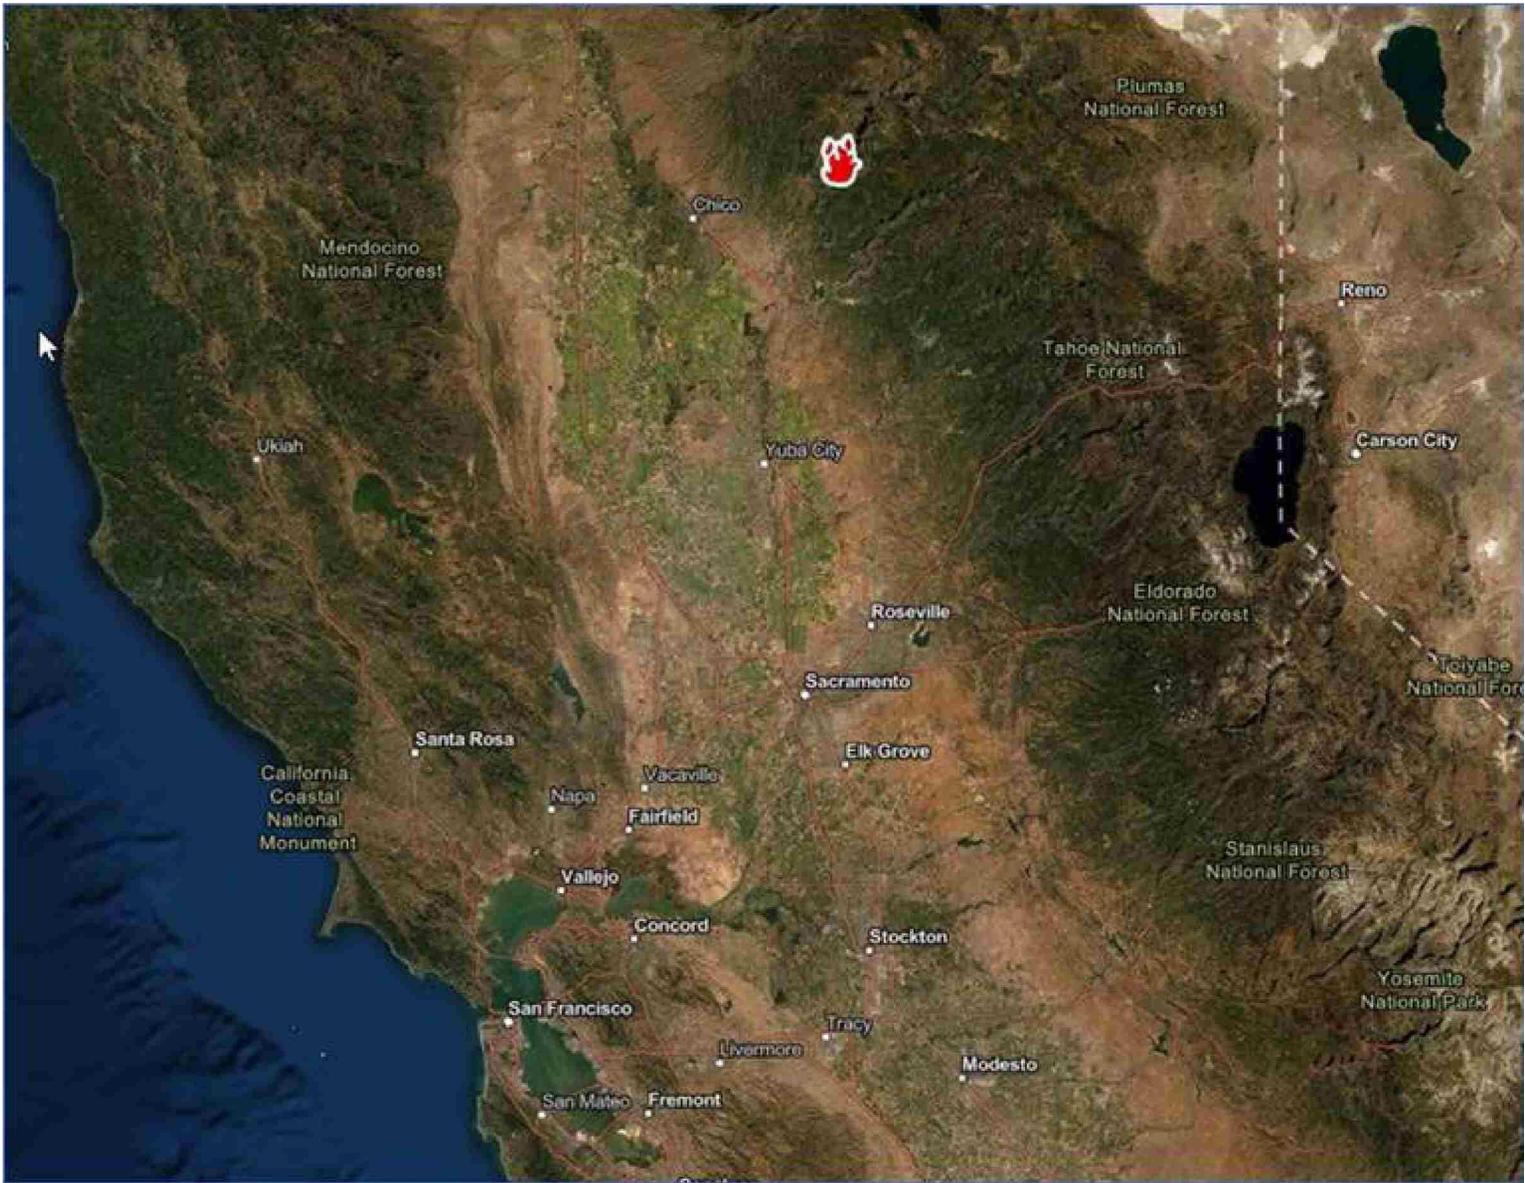

Hazard Awareness & Warning Center (HAWC)

To Subscribe to HAWC Incident Reports, please submit request to HAWC@pge.com

Some of the measures included in this document, email, presentation, or study are contemplated as additional precautionary measures to reduce the risk of wildfires.